


TYPICAL APPLICATION OF MULTIPLE BOARDS INSIDE DIFFERENT ELECTRICAL PANELS
DEDICATED PLC TRANSFORMERS PER UNIT.

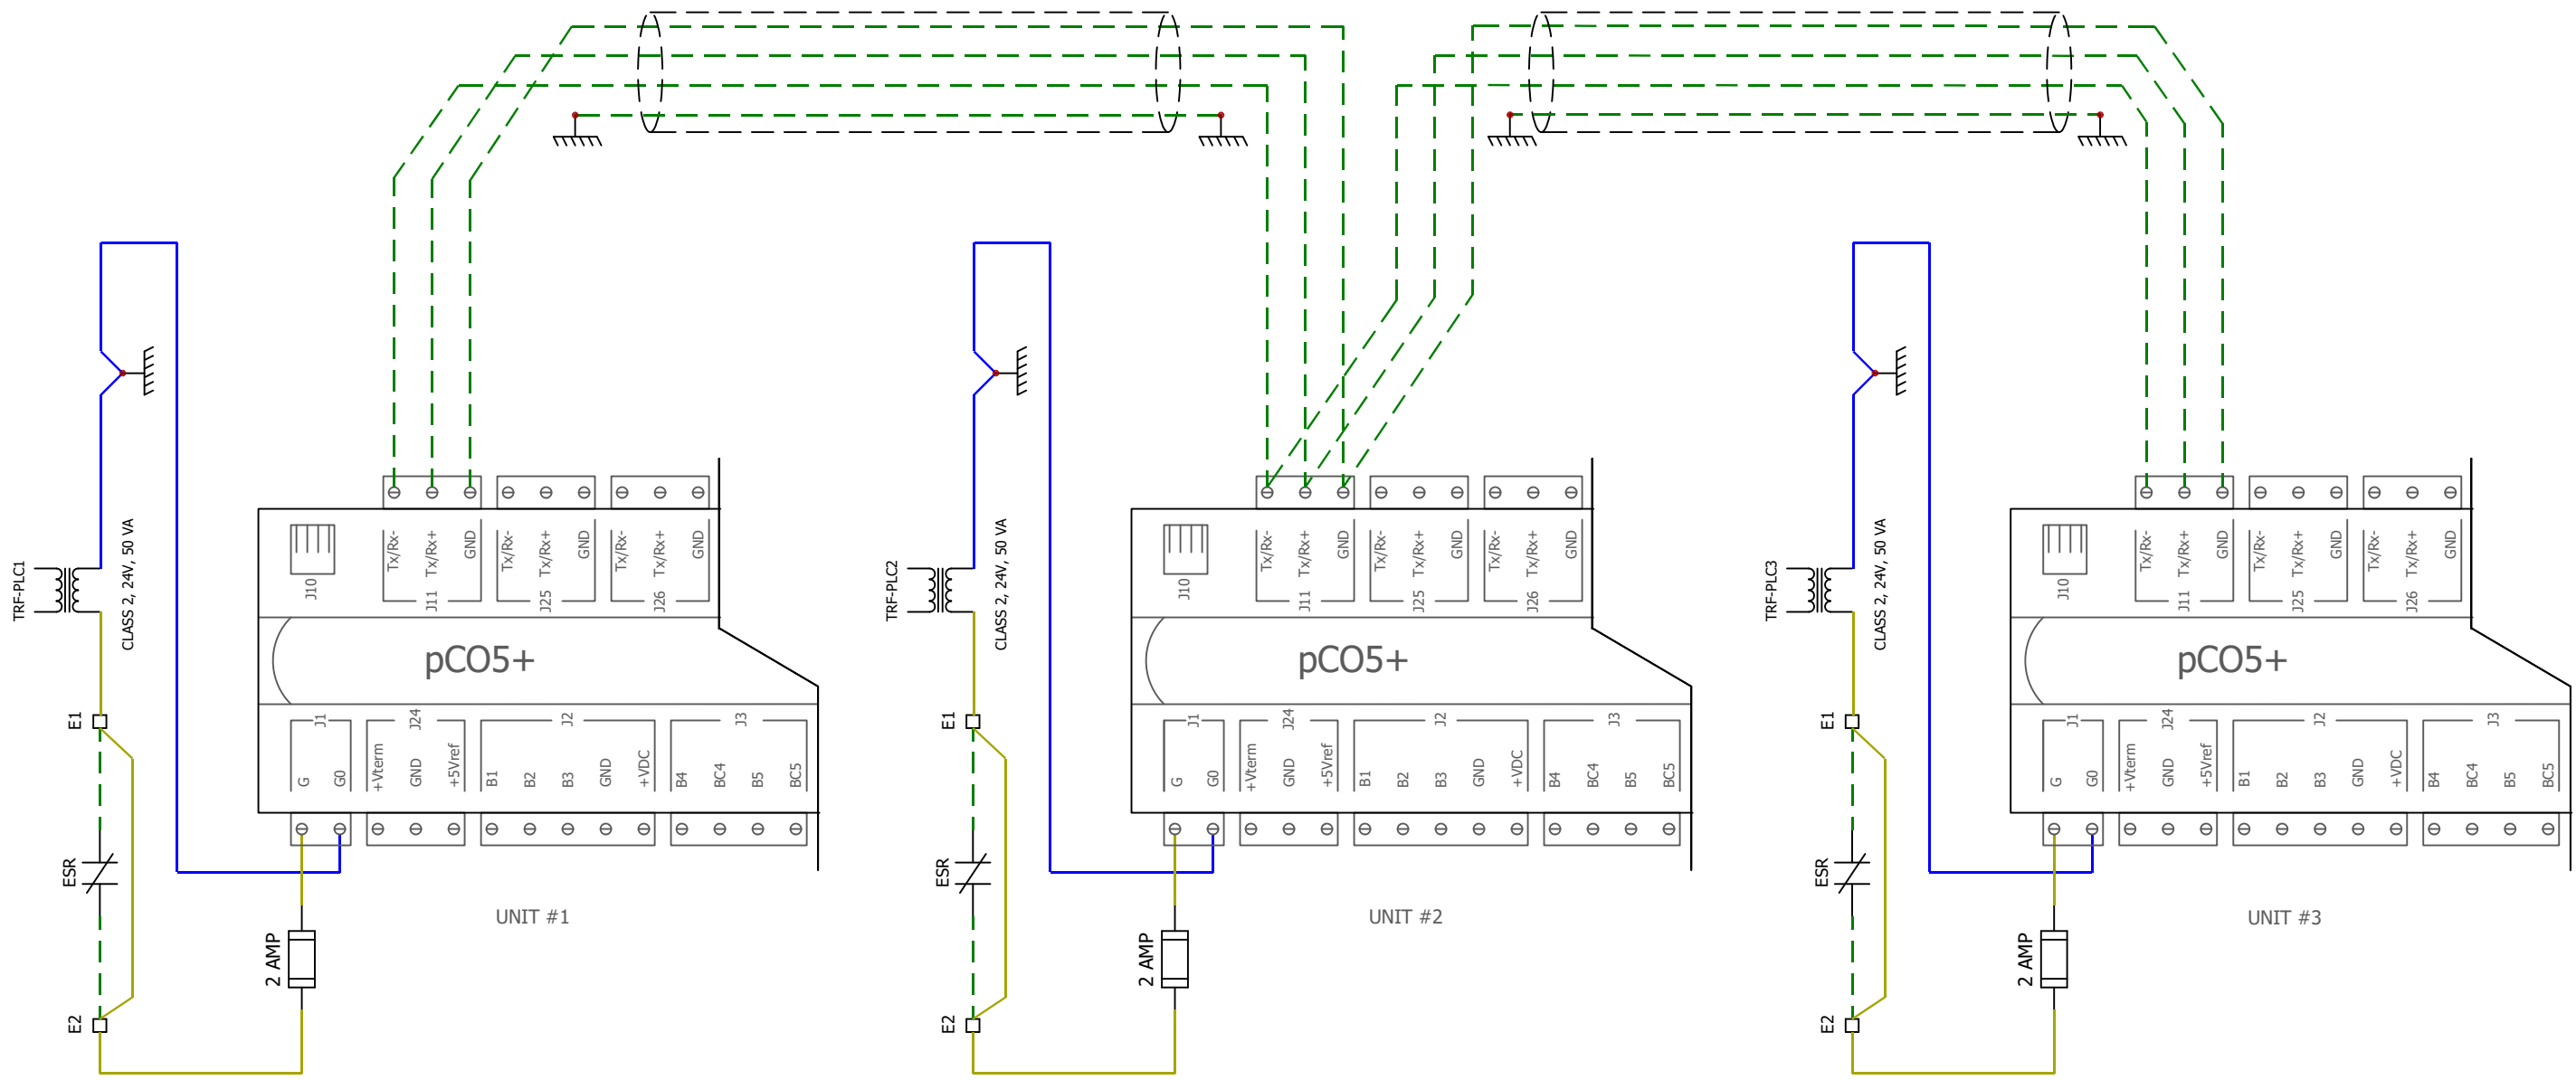

LEGEND

FIELD WIRING	
WIRING SHIELD	
COMMON	
24V POWER	

- NOTES
1. A MINIMUM OF AWG 22 SHIELDED CABLE MUST BE USED.
 2. A TOTAL OF THREE (3) UNITS MAY BE INTERLOCKED (DAISY-CHAINED) FOR MULTI-UNIT SEQUENCING.
 3. UNIT ADDRESSING IS PROGRAMMED DURING START-UP OF EQUIPMENT.

AboveAir Technologies, Inc.
5179 Mountville Rd.
Frederick, MD 21703

Multi-Unit Sequencing Wiring

pCO5+ MicroProcessor

REV.	DATE	NAME	CHANGES	REVISION
0	9/27/2022			0
ENGR: JPN			ENG MGR: MCR	SCHEME
				10

CONTRACT: LOCATION: L1 Main electrical closet

SOLIDWORKS Electrical